




VENTILATION OPTIONS

Please note, in all cases the back panel MUST BE removed before installation.

To enable the appropriate air flow, if possible, please ensure the side panels are not fitted directly to the back wall. We advise a 35mm void.

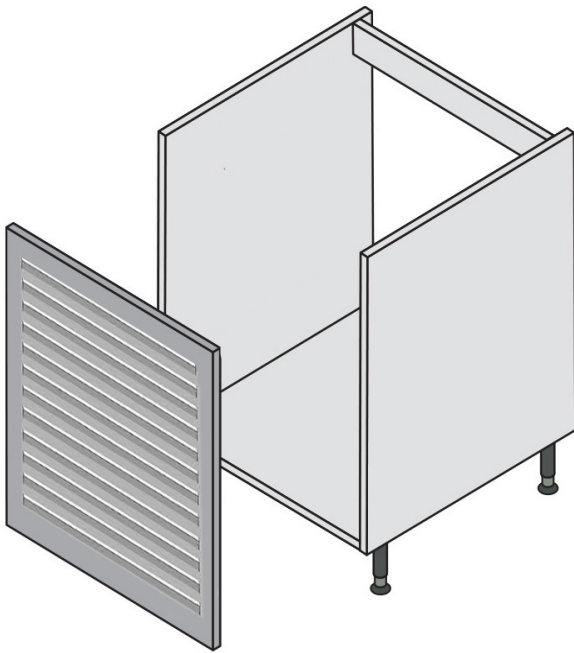

FULLY LOUVERED DOOR (For a base cabinet installation ONLY)

Bottling systems require a fully louvered front cabinet door as standard and the base cabinet back panel should be totally removed.

PLEASE NOTE:

The air temperature in the kitchen area should not exceed air temperature of 32°C.

PLEASE NOTE:

This should be agreed at the survey stage.
It is the customers responsibility to provide a fully louvered door, or agree to the door being removed totally.



VENTILATION GRILLS

Aqua Libra Co supplies the below ventilation grills. Please contact the install team to discuss and confirm if your preferred option or bespoke ventilation grills can be used.

Ventilation Grill (450 x 70 mm)

Recess Mounting

Matt Silver

Ventilation area 81.22 cm²


Length 450 mm (recessed length 424 mm)

Height: 70 mm

Oval slots arranged in parallel

Installation: For press fitting and screw mounting

CUT OUT SIZE = WIDTH: 428MM & DEPTH: 60MM

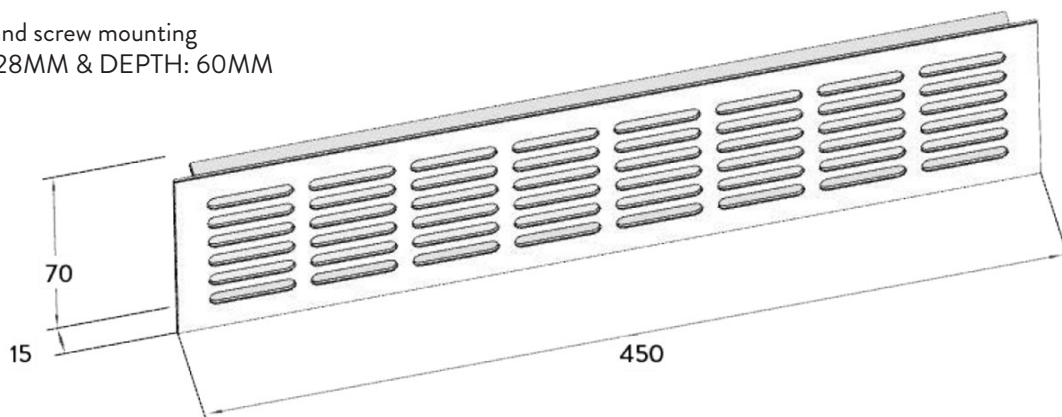

Ventilation Grill (450 x 100 mm)

Recess Mounting

Silver F1


Ventilation area 142 cm²

Height 100 mm (recessed height 86mm)

Length: 400mm (flange length 76mm)

Oval slots arranged in parallel

Installation: For press fitting and screw mounting

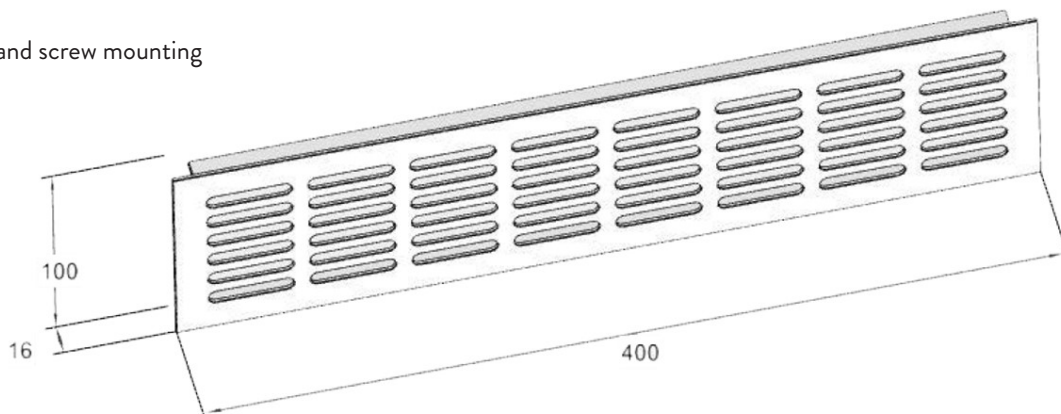

TALK TO US

London showroom: 1 New Street, London, EC2M 4TP

www.aqualibra.com | 0800 080 6696 | hello@aqualibra.com